
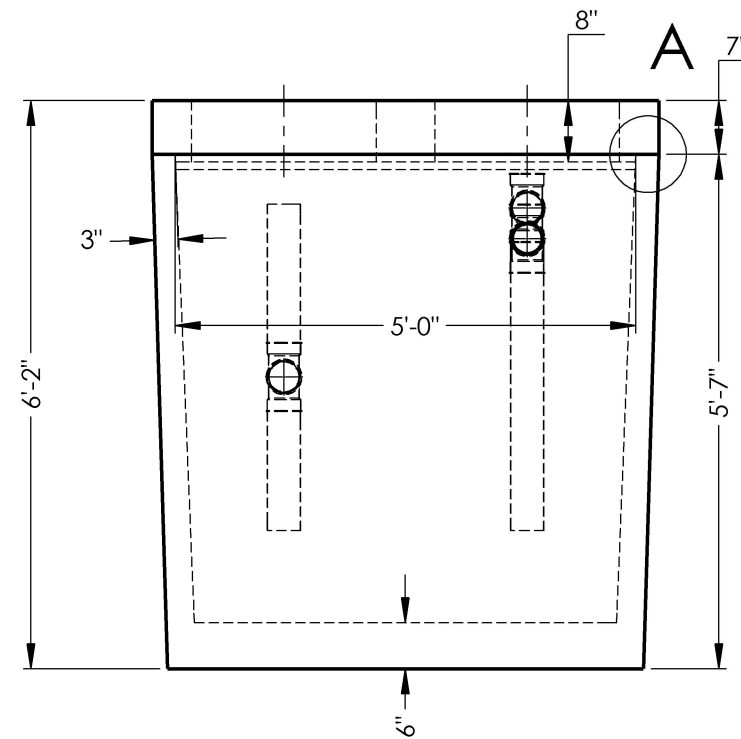
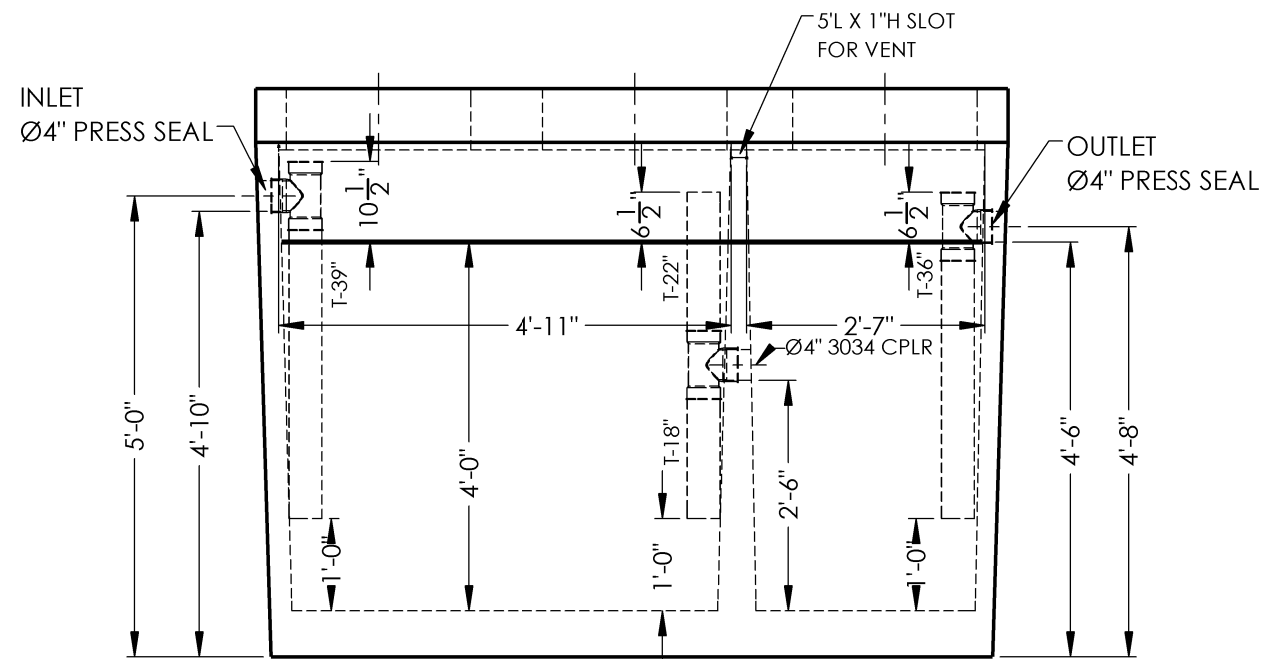
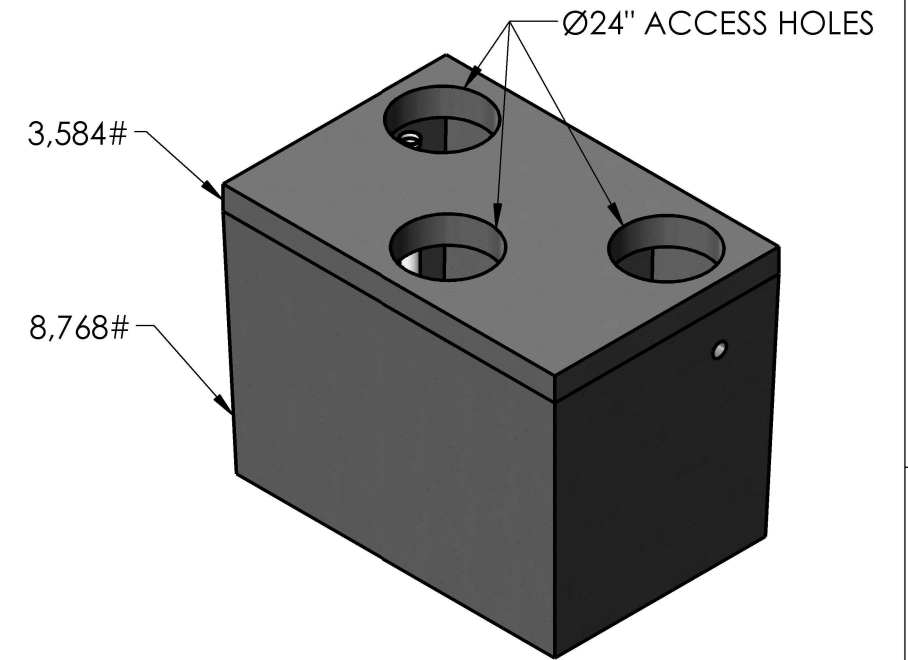
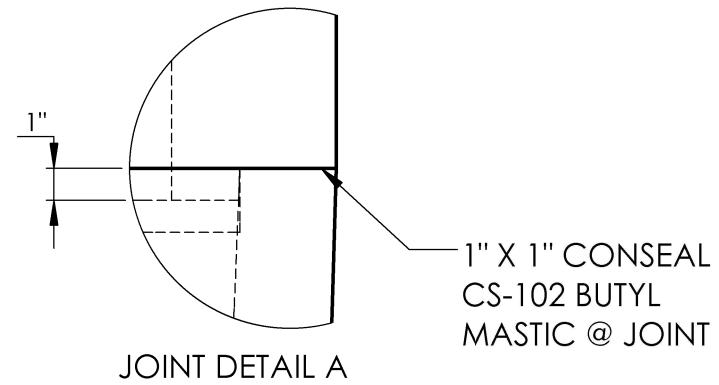


WARRANTY: ALL TANKS MUST BE BACKFILLED AND COMPACTED PRIOR TO FILLING OR WARRANTY IS VOID.

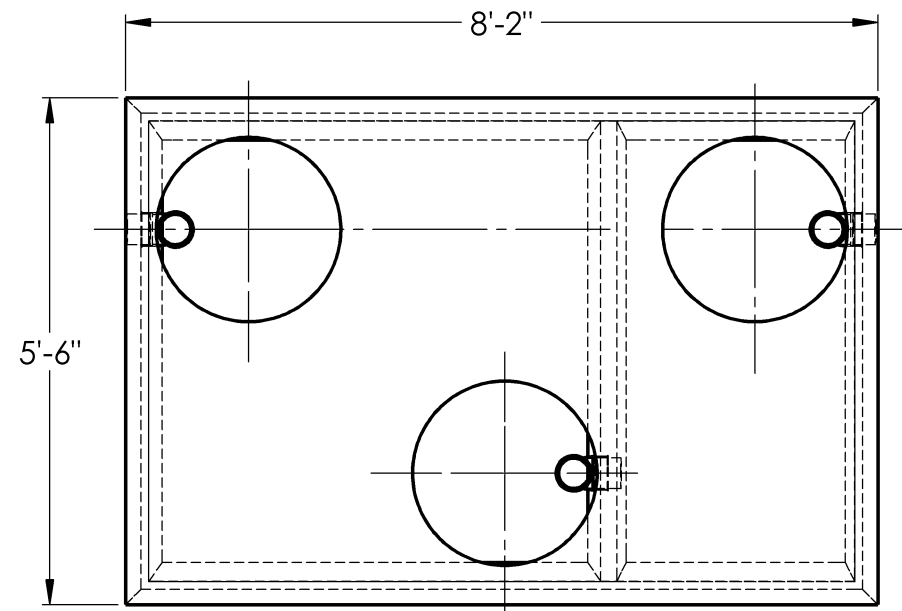

CONCRETE:

TANK CONSTRUCTION UTILIZES 6000 PSI CONCRETE
AND GRADE 60 REBAR.

GALLON CALCS:

5'-0"W x 4'-11"L x 4'-0"H x 7.48 = 723 GALLONS
5'-0"W x 2'-7"L x 4'-0"H x 7.48 = 374 GALLONS

RISERS:

PVC : Ø24" & FIB. COVER (TO GRADE)
CONCRETE: Ø24" x 8" OR 12" (6" BELOW GRADE)

BEDDING :

4" PEA GRAVEL OR COMPACTED CRUSHED GRAVEL
(NO WATER PRESENT)

EXCAVATION:

12" LARGER EACH WAY THAN TANK DIM.
MAX COVER ON TOP 5'-0"

NOTES:

REINFORCEMENT: -#4 BARS @ 5" O.C.E.W. IN TOP, (2) #4 EACH SIDE OF ACCESS -6X6 10 GA WIRE MESH IN SIDES UP 12" FROM BOTTOM -6X6 10 GA WIRE MESH IN BOTTOM -#3 BAR 12" DOWN FROM TOP HORIZONTAL CONTINUOUS LOOP #4 BARS @ 8" O.C.E.W. IN BOTTOM
--



**2215 E. BROOKLYN AVE
SPOKANE, WA 99217
TOLL FREE 1-800-888-4573
(509) 325-4573 FAX (509) 325-5098
SPOKANE - LEWISTON - YAKIMA
www.wilbertprecast.com**

DRAWN BY:
DCR

TITLE:

1000 GALLON DOUBLE COMPARTMENT
MONO GREASE INTERCEPTOR HEAVY

	SIZE
Small	8-9
Medium	10-11
Large	12-13
X-Large	14-16

B

DWG. NO.

#1627MGTTBWA 4"

SCALE:

NTS

DATE:

2/24/2023