
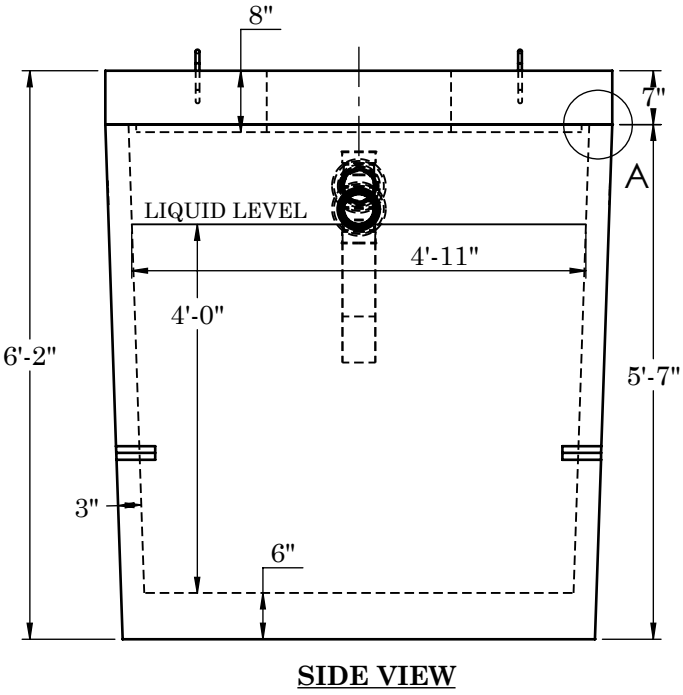
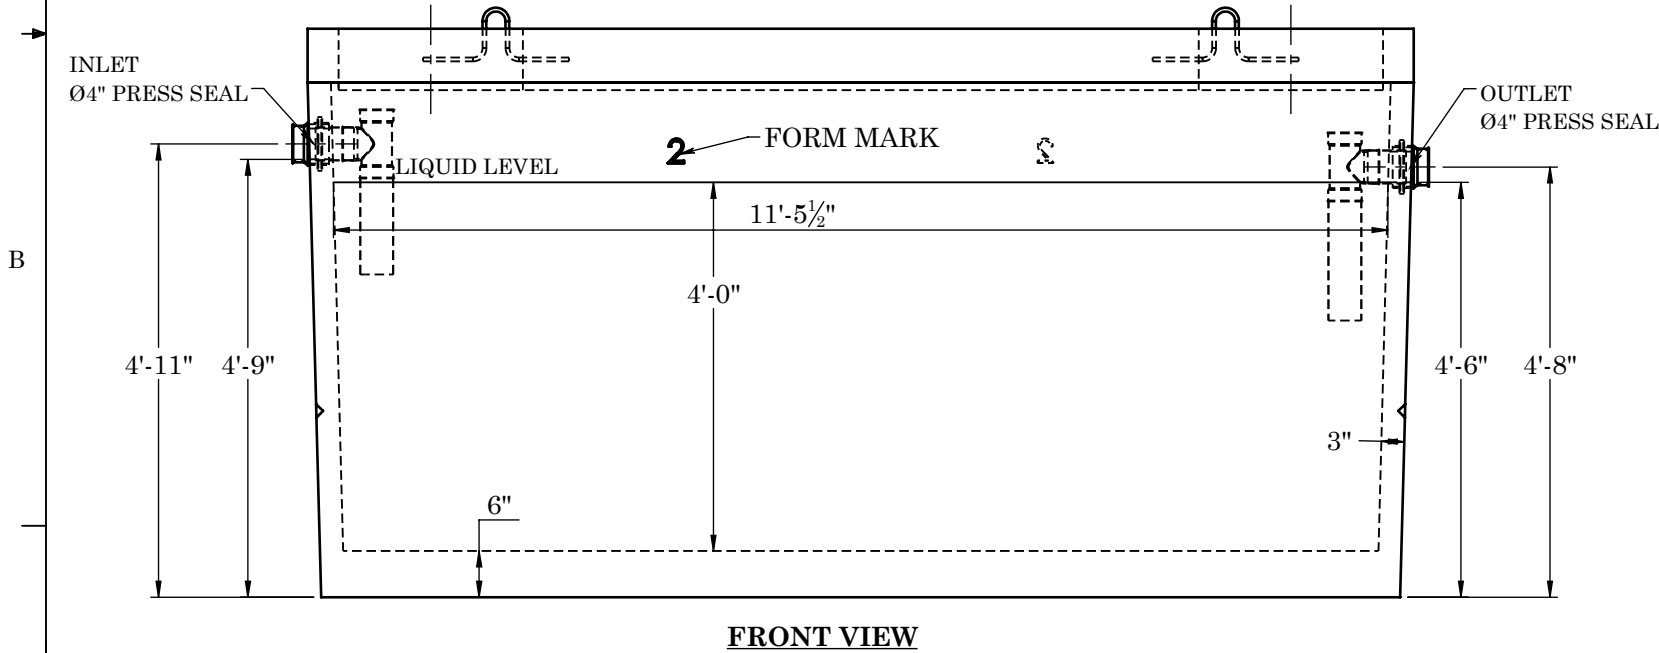


WARRANTY - ALL TANKS MUST BE BACKFILLED AND COMPACTED
PRIOR TO FILLING OR WARRANTY IS VOID

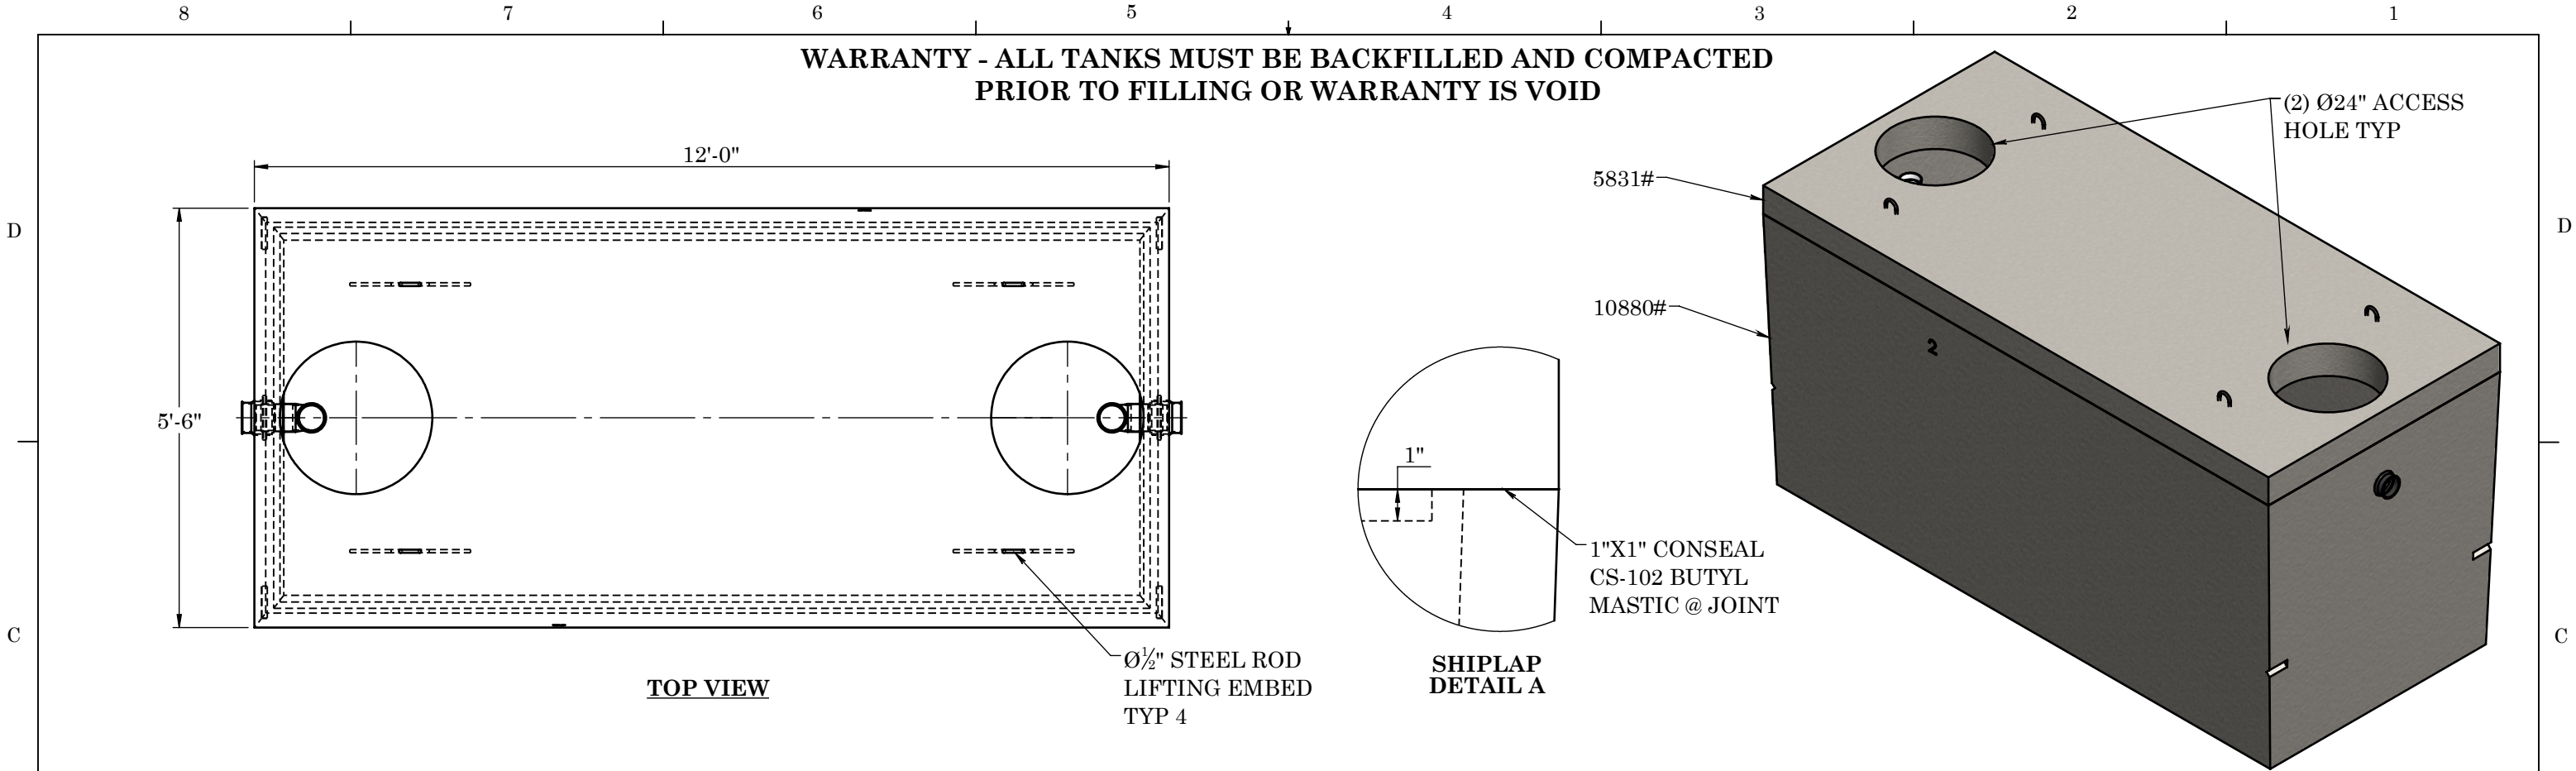

CONCRETE:
TANK CONSTRUCTION UTILIZES 6000 PSI
CONCRETE AND GRADE 60 REBAR

GALLON CALCS:
4'-11"W X 11'-5½"L X 4'-0"H X 7.48 = 1686 GALLONS

RISERS:
PVC: Ø24" RISER AND FIBER COVER(TO GRADE)
CONCRETE: Ø24" X 8" OR 12" (6" BELOW GRADE)

BEDDING:
4" PEA GRAVEL (NO WATER PRESENT)

EXCAVATION:
12" LARGER THAN TANK DIMENSIONS
EACH WAY. MAX BURY 3'-0"

</